

Test score report

Applicant address	Brand New Company 27, 37beongil, Dotjil-ro, Nam-gu, Ulsan Metropolitan City, 2nd floor (Sinjeong-dong)	KATRI NO	BSHA23-FC001068
Submission location		Date of receipt	October 27, 2023
Sample name	1 sample submitted by the client Asphyxiating fire extinguisher for fire prevention	Date of issue	November 2, 2023
		Purpose	For submission
		PAGE(S)	1 / 2

Test items

Test results

Sample 1

Heat resistance: Test method provided by applicant

Not melted

- * Note) 1. Test conditions: (1 400 ± 20) °C, 5 minutes
2. Judgment: Judgment of melting or not

[Sample photo attached]

Director of KATRI Testing & Research Institute

Tester: Kwon Jae-hyun



Chief Technology Officer: Park Jeong-gyu



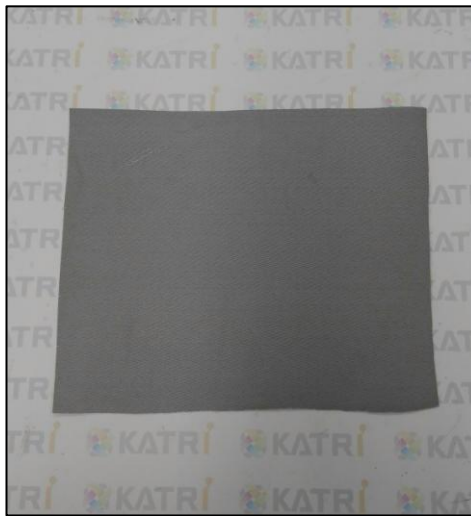

Test location: 101, Building B, Vision Tech Co., Ltd., 263 Gaejwa-ro, Geumjeong-gu, Busan

- 비고 1. 이 성적서는 신청자가 제시한 시료 및 시료명으로 시험한 결과로서 전체 제품에 대한 품질을 보증하지는 않습니다.
2. 이 성적서는 당 시험연구원의 사전 서면동의 없이 홍보, 선전, 광고 및 소송용으로 사용될 수 없으며, 용도 이외의 사용을 금합니다.
3. 이 성적서는 KS Q ISO/IEC 17025 및 KOLAS 인정과 관련이 없습니다.

KATRI NO: BSHA23-FC001068
PAGE(S): 2 / 2

IMAGE

Sample 1



- 비고 1. 이 성적서는 신청자가 제시한 시료 및 시료명으로 시험한 결과로서 전체 제품에 대한 품질을 보증하지는 않습니다.
- 이 성적서는 당 시험연구원의 사전 서면동의 없이 홍보, 선전, 광고 및 소송용으로 사용될 수 없으며, 용도 이외의 사용을 금합니다.
- 이 성적서는 KS Q ISO/IEC 17025 및 KOLAS 인정과 관련이 없습니다.